


**Table 4**  
**Pump & Treat Effluent Limited Chemicals in µg/L**  
**2018**

Month	TCA	Qualifier	PCE	Qualifier	TCE	Qualifier
January	0.38	< RL	0.68	J	0.43	J
February	0.38	< RL	0.70	J	0.73	
March	0.38	< RL	0.69	J	0.79	
April	0.38	< RL	0.68	J	0.73	
May	0.93		1.20		1.40	
June	2.9		0.78	J	6.0	
July	0.38	< RL	1.30		1.20	
August	0.86	J	1.50		1.3	
September	0.86	J	1.50	J	1.20	
October	0.24	J	0.15	<RL	1.00	
November	0.24	< RL	0.15	<RL	0.42	J
December	0.37	J	0.43	J	0.88	J
Reporting Limit	1.0		1.0		0.50	
Method Detection Limit	0.24		0.15		0.10	

J=Result is < the Reporting Limit but >= the Method Detection Limit & the concentration is an approximate value.

Avg.            0.843                            0.8                            1.79

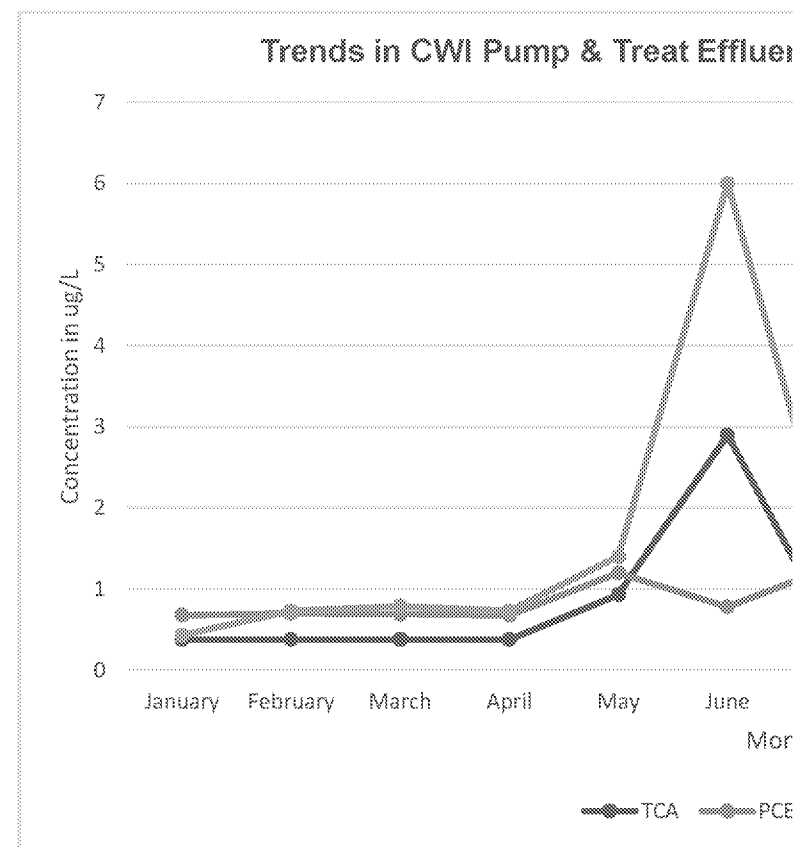

## nt Limited Chemicals in 2018

